

Report No.:

Test Time: 2023/4/4 16:11

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: LWA0137A

Luminous Width (mm): 135

Voltage: 220.1 V

Power: 5.43 W

Luminous Length (mm): 135

Luminous Height (mm): 0

Current: 0.057 A

Power Factor: 0.430

Photometric Results

IES NEMA Type: 4H x 7V

Measurement Flux: 43.8 lm

Field Lumens: 36.5 lm

Horizontal Diffuse Angle(50%): H78.1

Vertical Diffuse Angle(50%): V90

Luminaire Efficacy Rating (LER): 8.11

Max. Intensity: 55.23 cd

Total Rated Lamp Lumens: 43.8 lm


Efficiency: 100%

Field Efficiency: 83.46%


Central Intensity: 0.75 cd

Pos of Max. Intensity: H0 V-63

Picture Of Luminaire



Luminous Intensity Distribution Curve

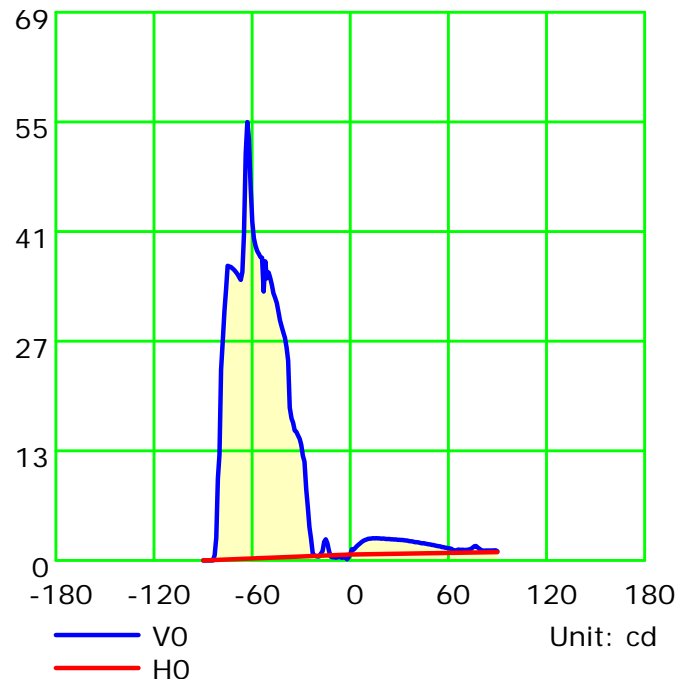

B Plane (°): -90.0-90.0: 90.0

Test Lab:

Test Type: TYPE B

Temperature:

Operator:

Beta Plane (°): -90.0-90.0: 1.0


Test Device: GPM-1800B

Distance: 9.950 m

Humidity:

Inspector:

Isocandela (rectangle)

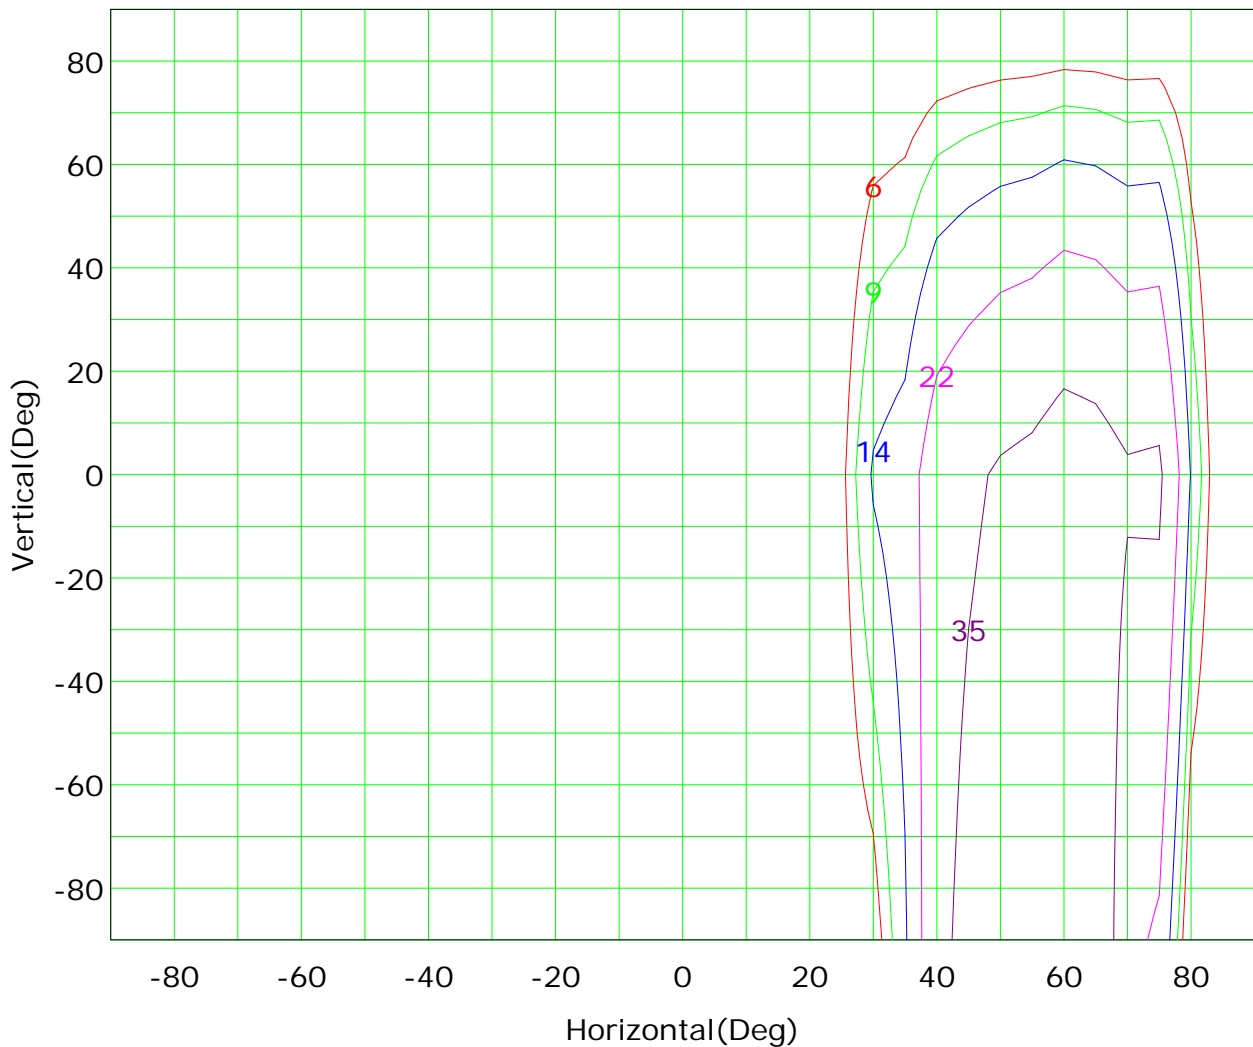

I_{max} (100%): 55 cd

— (10%):	6 cd	— (16%):	9 cd
— (25%):	14 cd	— (40%):	22 cd
— (63%):	35 cd	— (100%):	55 cd

B Plane (°): -90.0-90.0: 90.0

Test Lab:

Test Type: TYPE B

Temperature:

Operator:

Beta Plane (°): -90.0-90.0: 1.0


Test Device: GPM-1800B

Distance: 9.950 m

Humidity:

Inspector:

IsoLux Plot

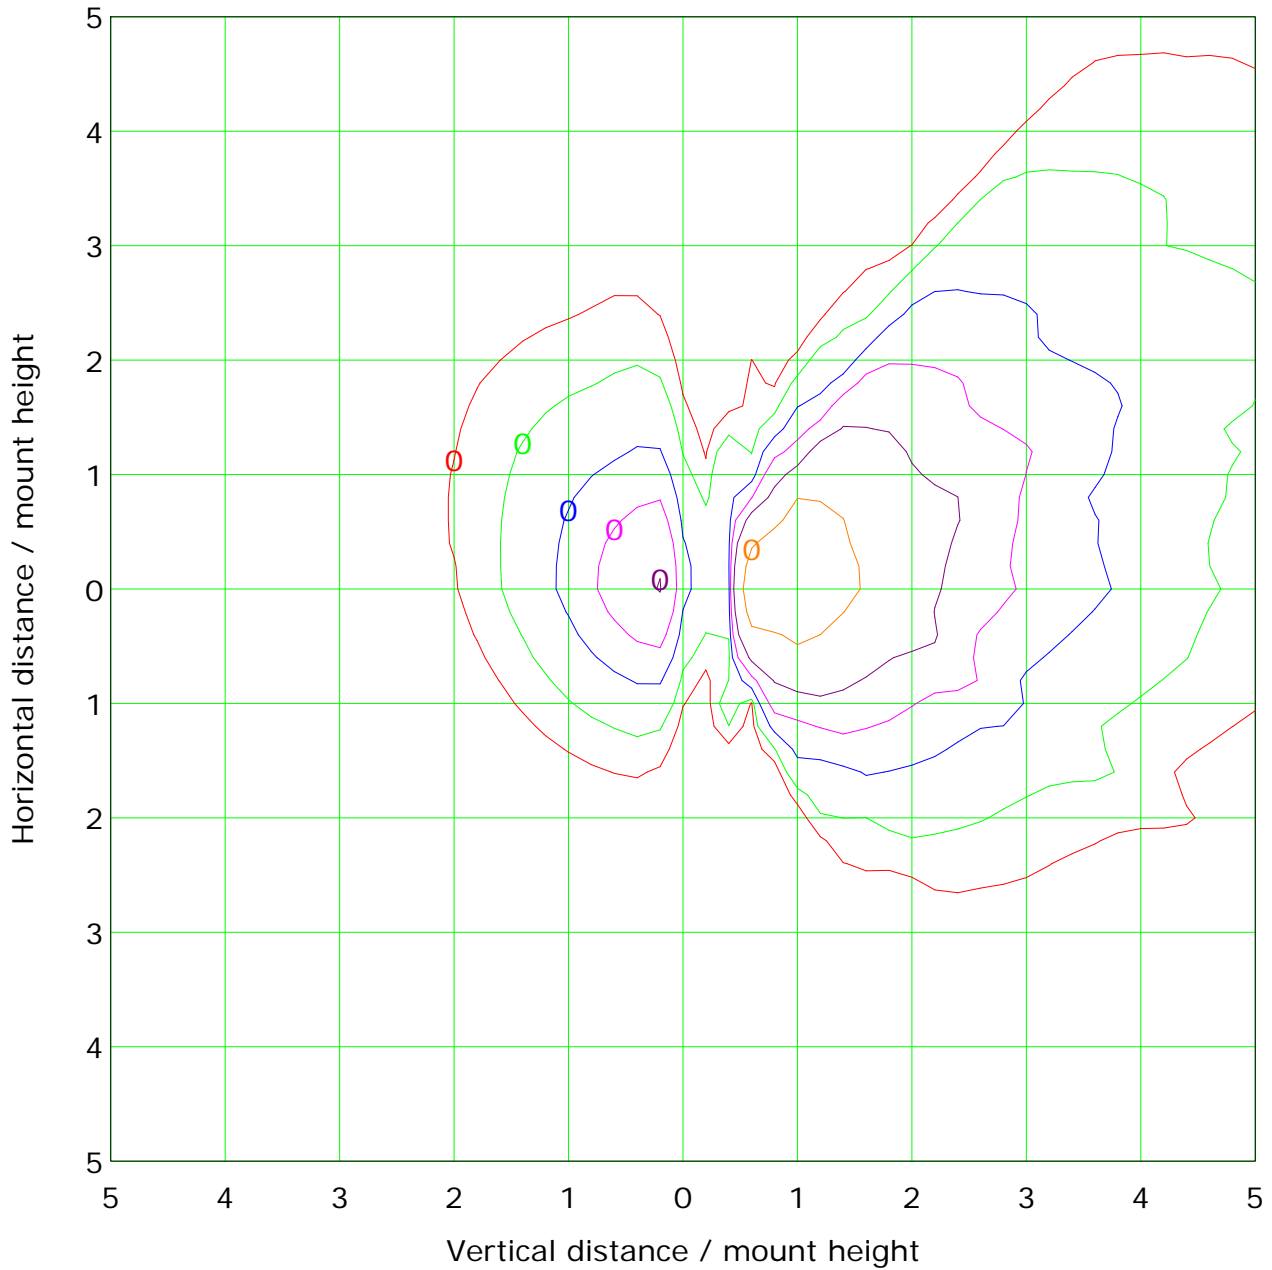


Mounting Height: 10.0m Max Lux(100%): 0.1 lx

— (1%): 0.0 lx	— (2%): 0.0 lx
— (5%): 0.0 lx	— (10%): 0.0 lx
— (20%): 0.0 lx	— (50%): 0.1 lx
— (100%): 0.1 lx	

B Plane (°): -90.0-90.0: 90.0
 Test Lab:
 Test Type: TYPE B
 Temperature:
 Operator:

Beta Plane (°): -90.0-90.0: 1.0
 Test Device: GPM-1800B
 Distance: 9.950 m
 Humidity:
 Inspector:

Illuminance at a Distance

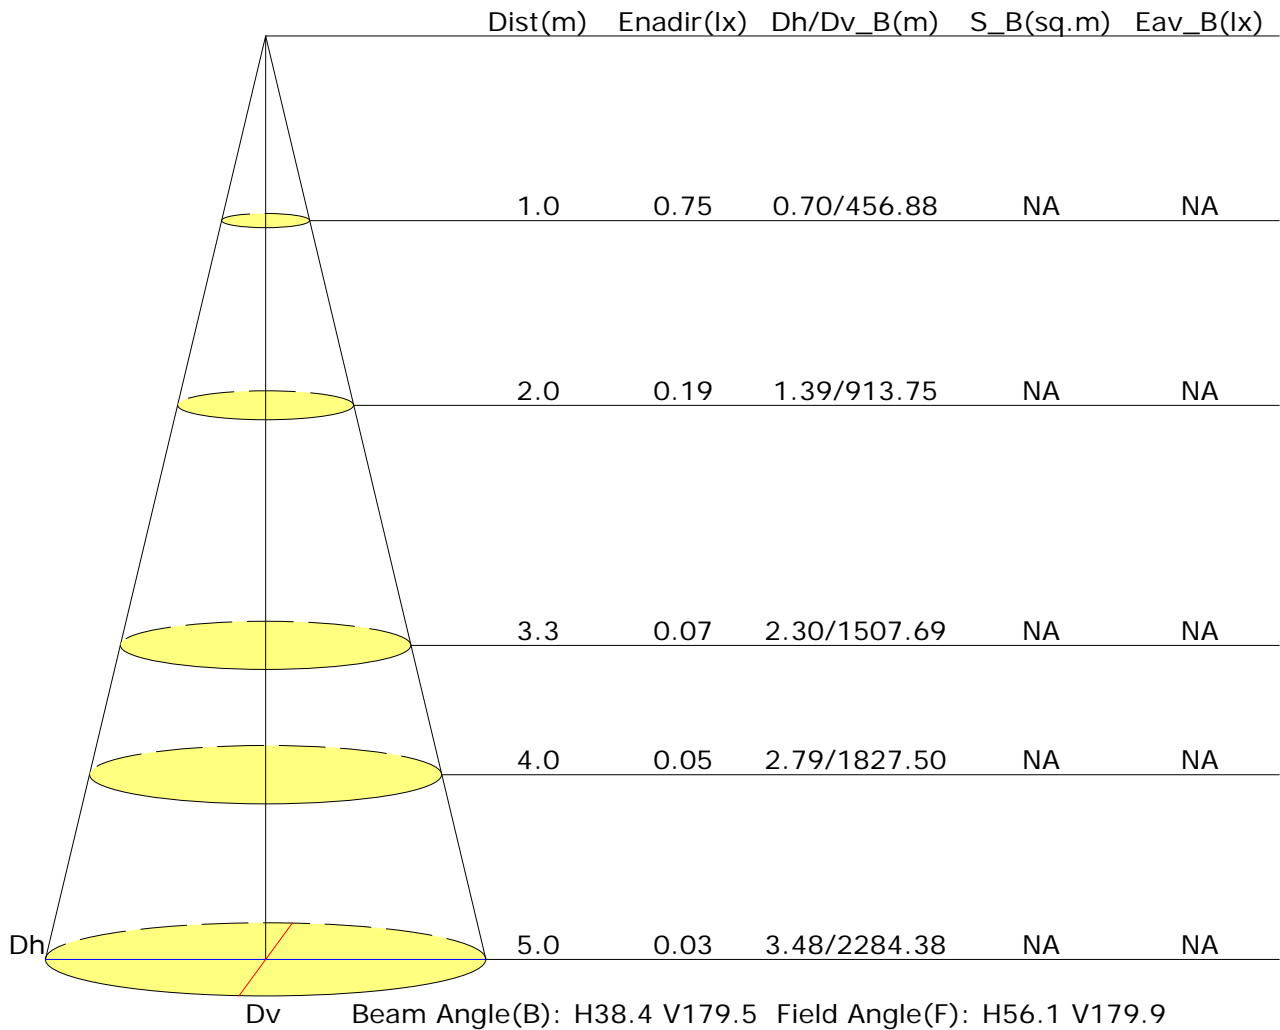

B Plane (°): -90.0-90.0: 90.0

Test Lab:

Test Type: TYPE B

Temperature:

Operator:

Beta Plane (°): -90.0-90.0: 1.0

Test Device: GPM-1800B

Distance: 9.950 m

Humidity:

Inspector:



Area Flux Table


		Vertical plane																					
		-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(E)	Flux(T)	
Horizontal plane	-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	
	-80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	3.0
	-70	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	7.7	7.8
	-60	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	9.2	9.3
	-50	0.0	0.0	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	9.8	9.9
	-40	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	5.8	6.0
	-30	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.9	1.7
	-20	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.5
	-10	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2
	0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.8
	10	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	1.1
	20	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	1.0
	30	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.9
	40	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.7
	50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4
	60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3
	70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2
	80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
																						44	
																						37	

Unit: lm

B Plane (°): -90.0-90.0: 90.0
 Test Lab:
 Test Type: TYPE B
 Temperature:
 Operator:

Beta Plane (°): -90.0-90.0: 1.0
 Test Device: GPM-1800B
 Distance: 9.950 m
 Humidity:
 Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

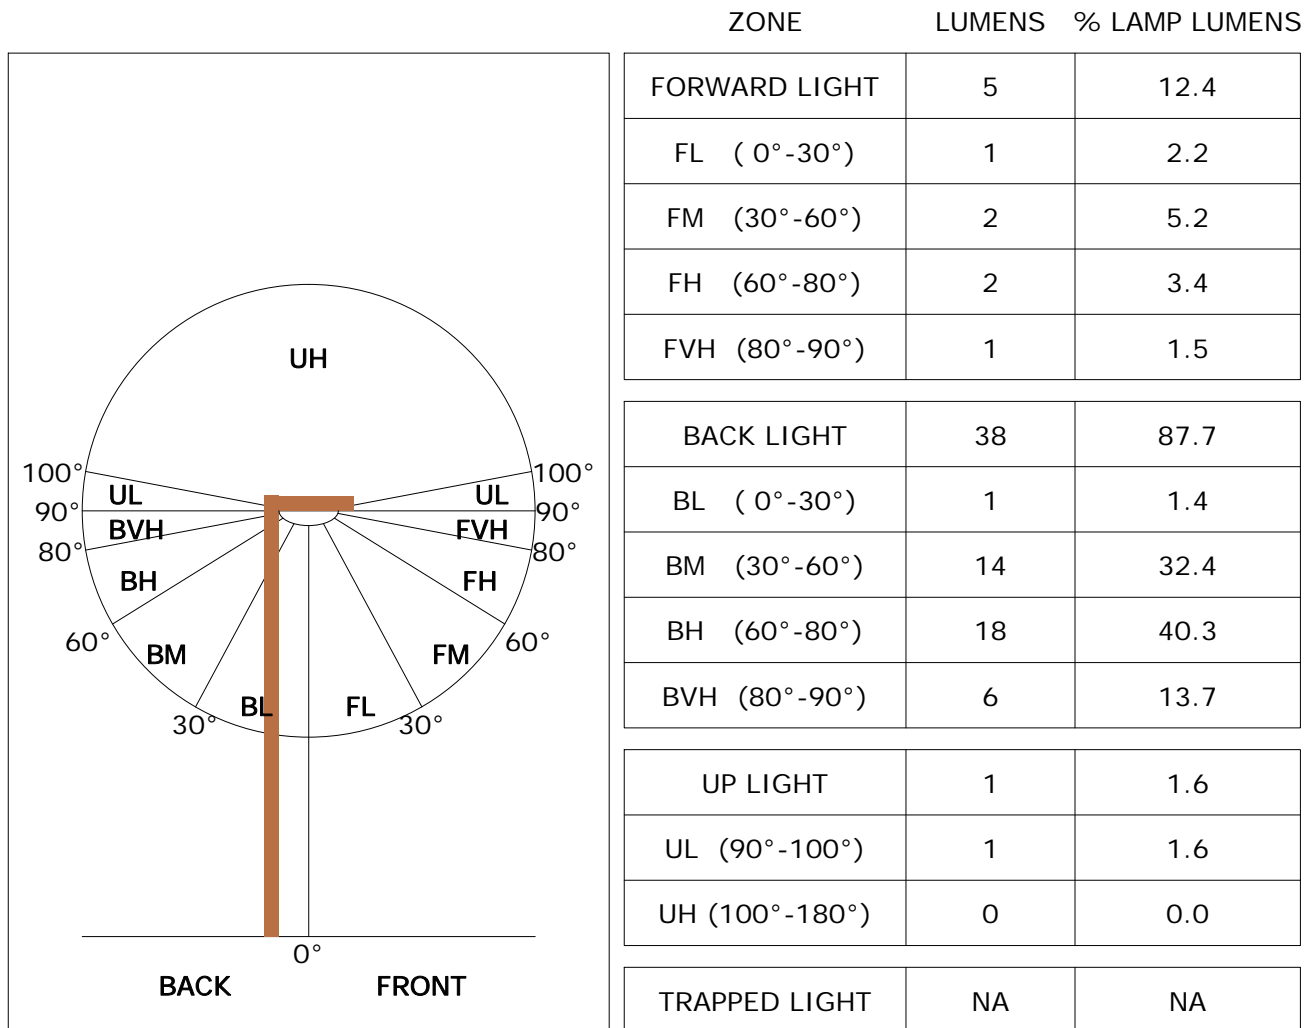

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B0 U1 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B0 U1 G0

B Plane (°): -90.0-90.0: 90.0
 Test Lab:
 Test Type: TYPE B
 Temperature:
 Operator:

Beta Plane (°): -90.0-90.0: 1.0
 Test Device: GPM-1800B
 Distance: 9.950 m
 Humidity:
 Inspector: